


INTEGRATION OF RENEWABLE ENERGY INTO MODERN POWER SYSTEMS: TECHNICAL, ECONOMIC, AND POWER QUALITY PERSPECTIVES

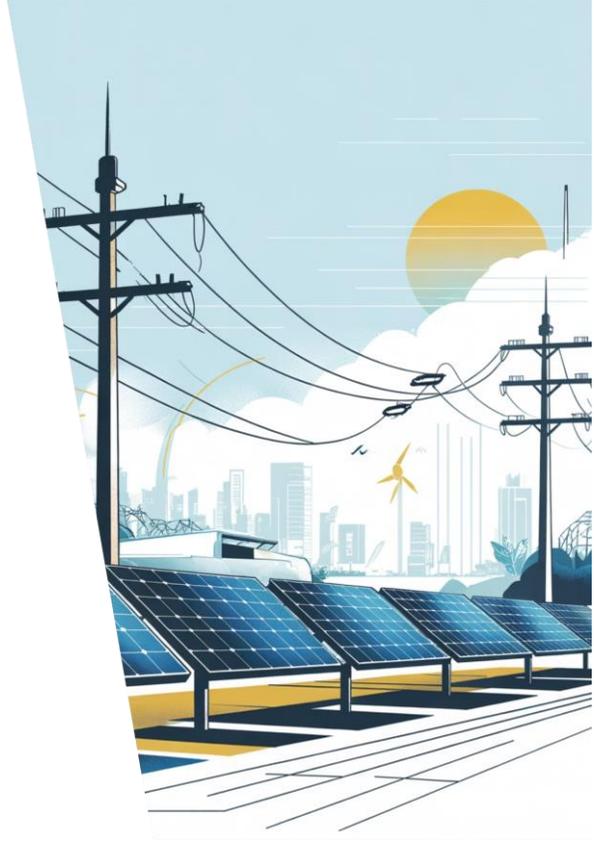

Serhat ISIKLI

ISBN: 978-625-5753-59-5

Ankara 2026

**INTEGRATION OF RENEWABLE ENERGY INTO
MODERN POWER SYSTEMS: TECHNICAL,
ECONOMIC, AND POWER QUALITY
PERSPECTIVES**

AUTHOR

Serhat ISIKLI

Electrical and Electronics Engineer

serhat.isikli@gmail.com

ORCID ID: 0009-0006-2507-0656

DOI: <https://doi.org/10.5281/zenoda.18346340>



Copyright © 2026 by UBAK publishing house

All rights reserved. No part of this publication may be reproduced, distributed or transmitted in any form or by

any means, including photocopying, recording or other electronic or mechanical methods, without the prior written permission of the publisher, except in the case of brief quotations embodied in critical reviews and certain other noncommercial uses permitted by copyright law. UBAK International Academy of Sciences Association

Publishing House®

(The Licence Number of Publicator: 2018/42945)

E mail: ubakyayinevi@gmail.com

www.ubakyayinevi.org

It is responsibility of the author to abide by the publishing ethics rules. UBAK

Publishing House – 2026©

ISBN: 978-625-5753-59-5

January / 2026

Ankara / Turkey

PREFACE

Electric power systems have been undergoing an unprecedented structural transformation in recent years. The rapidly increasing integration of renewable energy sources does not merely represent a diversification of generation technologies; it fundamentally reshapes the design, operation, and control philosophies of power systems. This transformation necessitates a re-examination of conventional power system approaches and the development of new engineering paradigms. For decades, electric grids were built around high-inertia synchronous generators, strong short circuit capacity, and predictable generation profiles. However, with the growing dominance of inverter based generation technologies such as wind and solar energy these fundamental assumptions are gradually losing their validity. Modern power systems are now characterized by increased variability, uncertainty, and complexity. This new operational environment requires holistic and interdisciplinary approaches that go beyond traditional engineering solutions.

This book aims to provide a comprehensive framework for the integration of renewable energy into modern power systems by jointly addressing technical, economic, and power quality perspectives. The core motivation of the book is rooted in the recognition that renewable energy integration is not merely a technological issue, but a system-level transformation. This transformation spans generation, transmission, and distribution levels, tightly interlinking system stability, power quality, flexibility, and economic sustainability.

Throughout the book, the discussion is not limited to theoretical models or purely academic perspectives. Instead, engineering challenges encountered under real grid conditions, field experience, and system operation considerations are placed at the forefront. This approach is intended to make the book a valuable reference not only for academics, but also for engineers working in transmission and distribution systems, project managers, system operators, and decision-makers.

In power systems with high renewable penetration, issues such as frequency and voltage stability, power quality disturbances, harmonic impacts, reduced short-circuit strength, and control interactions are no longer exceptional cases; they have become integral parts of daily system operation. Accordingly, modern solutions including the concepts of inverter-dominated grids, grid-forming inverters, HVDC technologies, energy storage systems, and FACTS devices are examined from a holistic perspective. The objective is not only to explain how these technologies operate, but also to clarify why they are necessary and how they should be effectively integrated into power systems.

Another key focus of this book is the strong linkage between technical analysis and economic evaluation. It is emphasized that investment decisions in renewable energy projects cannot rely solely on single indicators such as the levelized cost of energy (LCOE). Assessments that neglect system level costs and operational risks may lead to misleading conclusions. In this context, the book seeks to provide a balanced evaluation that integrates engineering judgment with economic realities.

Looking ahead, it is evident that power systems will evolve toward more digitalized, intelligent, and predictive structures. Digital twins, artificial intelligence assisted operational strategies, and advanced monitoring systems constitute the fundamental building blocks of this transformation. However, the successful implementation of these technologies depends on preserving the core principles of engineering discipline. While addressing technological innovations, this book deliberately maintains a critical, engineering based perspective.

In conclusion, this work aims to present the challenges faced by renewable energy dominated modern power systems, along with corresponding solution approaches, within a systematic and holistic framework. It is hoped that this book will serve not only as a reference source for professionals in the field of modern power systems, but also as an intellectual guide for all stakeholders involved.

Serhat ISIKLI

Electrical and Electronics Engineer

25.01.2026

SCOPE AND TARGET AUDIENCE

This book addresses the integration of renewable energy sources into modern electric power systems from a system-level engineering perspective. Its primary scope encompasses the technical, operational, and economic challenges that arise in power systems with high penetration levels of inverter-based renewable generation, particularly wind and solar energy.

Key topics covered in the book include the concept of inverter-dominated grids, frequency and voltage stability, power quality and harmonic impacts, fault ride-through (FRT) requirements, reduction in short-circuit strength, and control interactions within transmission and distribution systems. In addition, advanced enabling technologies such as grid-forming inverters, HVDC systems, energy storage technologies, FACTS devices, and digital monitoring solutions are examined within a coherent, application oriented, and holistic framework.

Rather than focusing solely on isolated theoretical models, the book emphasizes the interaction between renewable energy technologies and real-world power system behavior. Engineering practices, system operation requirements, and planning level decision-making processes are addressed in conjunction with analytical methods and international standards. Furthermore, the balance between system level costs, flexibility requirements, and investment decisions is evaluated in an integrated manner alongside the technical discussion.

The target audience of this book includes electrical and power system engineers working in transmission and distribution networks, renewable energy project developers, system operators, and technical

managers responsible for the planning and operation of modern power systems. The content is also suitable for graduate students and researchers seeking a comprehensive and practice oriented understanding of renewable energy integration.

By clearly defining its scope and target audience, this book aims to serve as a reliable reference for professionals and researchers involved in the design, operation, and transformation of future power systems.

ABBREVIATIONS

AC – Alternating Current

AI – Artificial Intelligence

AVR – Automatic Voltage Regulator

BESS – Battery Energy Storage System

CAPEX – Capital Expenditure

CO₂ – Carbon Dioxide

DC – Direct Current

DFIG – Doubly Fed Induction Generator

DLR – Dynamic Line Rating

ENTSO-E – European Network of Transmission System Operators for Electricity

ESS – Energy Storage System

FACTS – Flexible AC Transmission Systems

FL – Federated Learning

FRT – Fault Ride Through

GDP – Gross Domestic Product

GFMI – Grid-Forming Inverter

GFLI – Grid-Following Inverter

HVAC – High Voltage Alternating Current

HVDC – High Voltage Direct Current

IEA – International Energy Agency

IEC – International Electrotechnical Commission

IEEE – Institute of Electrical and Electronics Engineers

Inverter-Dominated Grid – Power system structure dominated by power-electronics-based sources

LCOE – Levelized Cost of Energy
LVRT – Low Voltage Ride Through
MMC – Modular Multilevel Converter
MMC-HVDC – Modular Multilevel Converter–Based HVDC
O&M – Operation and Maintenance
OPEX – Operational Expenditure
PCC – Point of Common Coupling
PLL – Phase-Locked Loop
PMSG – Permanent Magnet Synchronous Generator
PV – Photovoltaic
Q–V Control – Reactive Power–Voltage Control
SCADA – Supervisory Control and Data Acquisition
SCR – Short-Circuit Ratio
STATCOM – Static Synchronous Compensator
SVC – Static VAR Compensator
TSO – Transmission System Operator
VSC – Voltage Source Converter
VSC-HVDC – Voltage Source Converter–Based HVDC
Weak Grid – Power system characterized by low short-circuit strength and limited voltage/frequency stiffness

CONTENTS

PREFACE	4
SCOPE AND TARGET AUDIENCE.....	7
ABBREVIATIONS.....	9
INTRODUCTION	14
1. PARADIGM SHIFT IN POWER SYSTEMS	15
1.1 Global Energy Transition and the Evolution of Grid Structures	16
1.2 Transition from Conventional Systems to Inverter-Dominated Grids	17
1.3 Increasing Complexity in Transmission and Distribution Systems	17
1.4 Scope and Methodological Approach of This Book	18
2. IMPACTS OF RENEWABLE ENERGY SOURCES ON THE POWER GRID	18
2.1 Characteristic Features of Wind and Solar Energy.....	19
2.2 Variability and Uncertainty.....	21
2.3 The Concept of Weak Grids and Its Technical Implications.....	22
2.4 Impacts on Power Flow, Voltage Profiles, and Stability	23
3. POWER-ELECTRONICS-BASED INTEGRATION AND INVERTER-DOMINATED GRIDS	24
3.1 The Role of Power Electronics in Modern Grids	25
3.2 DFIG, PMSG, and PV Inverter Structures	26
3.3 Grid-Following and Grid-Forming Inverters.....	27
3.4 Impact of Control Strategies on System Behavior	29
4. HIGH-RENEWABLE-PENETRATION POWER SYSTEMS AND STABILITY CHALLENGES.....	30
4.1 Frequency and Voltage Stability	31
4.2 Reduced Short-Circuit Strength Problems.....	32
4.3 Fault Ride-Through (FRT) Requirements	33
4.4 Operational Risks from a System-Operator Perspective	34
5. POWER QUALITY PROBLEMS AND HARMONIC IMPACTS	35

5.1 Fundamental Sources of Harmonics	36
5.2 Power Quality Issues in Renewable Energy Facilities.....	37
5.3 IEEE 519 and IEC 61000 Standards.....	38
5.4 Active, Passive, and Hybrid Filtering Solutions	39
6. HVDC AND ADVANCED TRANSMISSION TECHNOLOGIES.....	41
6.1 Role of HVDC Systems in Renewable Energy Integration.....	42
6.2 VSC-HVDC and MMC-HVDC Architectures	43
6.3 Offshore and Remote-Area Integration	44
6.4 Stability and Control Perspective.....	45
7. ENERGY STORAGE AND ENABLING TECHNOLOGIES	46
7.1 Types of Energy Storage Systems and Grid Integration	47
7.2 Role of FACTS Devices (STATCOM, SVC).....	48
7.3 Flexibility in Renewable Energy Integration	49
7.4 Operational and Planning Impacts.....	50
8. TECHNICAL–ECONOMIC ASSESSMENT AND SYSTEM PLANNING	51
8.1 Concepts of LCOE, CAPEX, and OPEX	51
8.2 Economic Impacts of Renewable Energy Integration.....	52
8.3 Transmission Losses and Optimization.....	53
8.4 Engineering Perspective for Decision-Makers	54
9. FUTURE POWER SYSTEMS	55
9.1 Grid-Forming Inverters	56
9.2 Digital Twins and Advanced Monitoring.....	57
9.3 Artificial Intelligence–Assisted Grid Operation.....	59
9.4 Emerging Trends in Energy Systems.....	60
10. CONCLUSIONS AND OVERALL ASSESSMENT	61
10.1 Key Insights from the Technical Transformation	61
10.2 Integrated Consideration of Power Quality and System Stability....	62

10.3 Assessment from Technical–Economic and Operational Perspectives	63
10.4 Future Outlook and Strategic Implications	64
10.5 Overall Evaluation	65
REFERENCES	66

INTEGRATION OF RENEWABLE ENERGY INTO MODERN POWER SYSTEMS: TECHNICAL, ECONOMIC, AND POWER QUALITY PERSPECTIVES

Serhat ISIKLI

INTRODUCTION

Over the past two decades, energy systems have undergone a profound transformation driven not only by the deployment of new generation technologies, but also by the impact of these technologies on existing grid structures and operational dynamics. Power systems that were traditionally shaped around centralized, large-scale, and predictable synchronous generators are now evolving toward distributed, flexible, and power-electronics-intensive structures with a high penetration of renewable energy sources. This transition represents not merely a technical change, but a structural paradigm shift that requires the re-examination of planning, operation, protection, and economic assessment approaches.

The integration of renewable energy has become an unavoidable necessity for ensuring energy supply security and reducing carbon emissions. However, the increasing share of resources such as wind and solar energy—characterized by variable and uncertain generation profiles—introduces multidimensional impacts on the dynamic behavior of power systems. This situation challenges classical power system assumptions and necessitates a re-evaluation of fundamental

issues such as frequency and voltage stability, power quality, short-circuit strength, and system flexibility (IEA, 2023; IEEE PES, 2020).

This book presents a system-oriented approach to the integration of renewable energy into modern power systems by jointly addressing technical, economic, and power quality dimensions. In the subsequent chapters, following an overview of energy resources and global transformation dynamics, inverter-dominated grid structures, stability and power quality challenges, advanced transmission technologies, energy storage solutions, and emerging trends in future power systems are examined from a holistic perspective.

1. PARADIGM SHIFT IN POWER SYSTEMS

This chapter addresses the structural transformation of power systems driven by the increasing integration of renewable energy sources within a conceptual framework. The transition from traditional synchronous-generator-based grid structures to power-electronics-intensive and control-oriented systems is not limited solely to changes in generation technologies. Rather, this transformation entails a fundamental reconfiguration of grid topology, operational strategies, stability mechanisms, and planning approaches.

Within the scope of this chapter, the impacts of the global energy transition on grid structures, the emergence of the inverter-dominated grid concept, the underlying causes of increasing complexity in transmission and distribution systems, and the methodological approach adopted in this book are systematically discussed. This framework establishes a foundational reference point for the technical

and economic analyses presented in the subsequent chapters of the book.

This paradigm shift is conceptually illustrated in Figure 1.

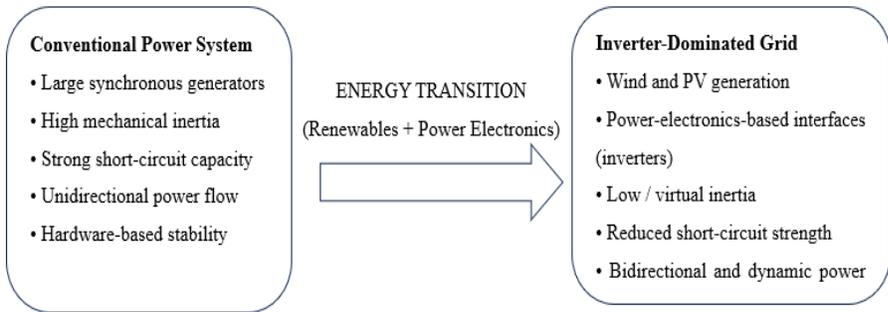


Figure 1. Transition from conventional power systems to inverter-dominated grids

1.1 Global Energy Transition and the Evolution of Grid Structures

Global energy policies are increasingly shifting from fossil-fuel-based generation toward low-carbon and renewable energy sources in response to climate change mitigation, energy supply security, and sustainable development objectives. Reports published by the International Energy Agency (IEA) indicate that electricity generation portfolios are rapidly evolving in many countries, with wind and solar energy becoming dominant in new installed capacity investments (IEA, 2023; IEA Wind, 2020).

Traditional power systems were built around centralized generation structures consisting of large-scale thermal, hydroelectric, and nuclear power plants. This synchronous-generator-dominated architecture enabled stable and reliable operation over many decades due to high

mechanical inertia, strong short-circuit capacity, and predictable operating conditions (Kundur, 1994).

However, the widespread deployment of renewable energy sources has increasingly challenged this conventional structure. Distributed generation, bidirectional power flows, and power-electronics-based grid interfaces have rendered grid behavior more flexible, yet simultaneously more complex (ENTSO-E, 2022).

1.2 Transition from Conventional Systems to Inverter-Dominated Grids

A significant portion of renewable energy technologies is connected to the grid through power electronic inverters rather than synchronous generators. This development has led to the emergence of a new operational regime in modern power systems, commonly referred to as inverter-dominated grids (Lasseter, 2011).

In such systems, frequency and voltage are no longer primarily governed by mechanical inertia, but are instead established and regulated through software-based control algorithms. If these control strategies are inadequately designed or poorly coordinated, severe stability issues may arise, particularly under high renewable penetration levels (Energies, 2021).

1.3 Increasing Complexity in Transmission and Distribution Systems

The integration of renewable energy sources has significantly transformed the traditional roles of transmission and distribution

systems. Distribution networks are no longer passive infrastructures; they have evolved into dynamic systems incorporating active generation, energy storage, and flexible loads (Sustainability, 2022).

At the transmission level, large-scale renewable power plants—often located in remote regions—have altered power flow patterns and pushed operational limits. These changes introduce new challenges related to congestion management, system security, and dynamic performance (Applied Energy, 2020).

1.4 Scope and Methodological Approach of This Book

This book presents a holistic approach to the integration of renewable energy into modern power systems by jointly addressing technical, economic, and power quality perspectives. The analysis integrates theoretical foundations, international standards (IEEE, IEC), and engineering insights derived from practical field experience.

Through this approach, the book aims to serve not only academic audiences but also system operators, engineers, project managers, and decision-makers involved in the planning and operation of contemporary power systems.

2. IMPACTS OF RENEWABLE ENERGY SOURCES ON THE POWER GRID

The integration of renewable energy sources into electric power systems represents not only a diversification of generation technologies, but also a fundamental influence on the physical, dynamic, and operational characteristics of the grid. Nature-dependent

generation sources such as wind and solar energy challenge long-standing assumptions of conventional power systems, including predictability, high inertia, and strong short-circuit capacity. Consequently, a thorough and accurate assessment of the grid impacts of renewable energy integration is of critical importance for the secure and efficient operation of modern power systems.

This chapter examines the fundamental characteristics of wind and solar energy, explains the concepts of variability and uncertainty, discusses the weak grid phenomenon and its technical implications, and evaluates the effects on power flow, voltage profiles, and system stability from an engineering perspective.

2.1 Characteristic Features of Wind and Solar Energy

Wind and solar energy are among the fastest-growing renewable technologies in global electricity generation. Key drivers of this growth include technological maturity, declining investment costs, modular design, and environmental benefits. However, the physical mechanisms underlying these generation sources differ significantly from those of conventional power plants.

Wind energy is based on the conversion of the kinetic energy of air movements—caused by atmospheric pressure differences—into electrical energy. The power output of wind turbines is proportional to the cube of wind speed, meaning that even small variations in wind velocity can result in substantial fluctuations in power generation. In addition, wind regimes exhibit both temporal and spatial variability

depending on factors such as topography, elevation, surface roughness, and meteorological conditions (Ackermann, 2012).

Solar energy generation relies on the direct conversion of solar irradiance into electrical energy through photovoltaic (PV) panels. The output of PV systems is influenced by several factors, including solar irradiance levels, cloud cover, panel temperature, and tilt angle. The daily generation profile typically features a pronounced daytime peak, with zero production during nighttime hours. While this predictable diurnal pattern is often considered an advantage compared to wind energy, short-term phenomena such as rapid cloud movements can still cause significant power fluctuations (IEA PVPS, 2022).

Both wind and solar energy sources are connected to the grid via power-electronics-based inverters rather than synchronous generators. While this interface provides enhanced controllability and flexibility in power injection, it also makes system dynamics increasingly dependent on inverter control strategies (Energies, 2021).

Table 1. Key Characteristics of Wind and Solar Energy from a Grid Integration Perspective

Feature	Wind Energy	Solar Energy
Generation characteristics	Highly variable, stochastic	Diurnal-cycle-based, relatively predictable
Time scale of variability	Seconds to hours	Minutes to days

Feature	Wind Energy	Solar Energy
Grid connection	DFIG / PMSG with inverter interface	Fully inverter-based
Inertia contribution	Low / virtual	None / virtual
Voltage impact	Flicker, voltage oscillations	Voltage rise
Control requirements	Medium to high	High
Impact on distribution networks	Limited	Highly pronounced

2.2 Variability and Uncertainty

One of the fundamental challenges encountered in the integration of renewable energy sources into power systems is related to the concepts of variability and uncertainty. Although these terms are often used together, they represent distinct technical phenomena.

Variability refers to the inherent temporal fluctuations in power generation. For instance, intra-day changes in wind speed or seasonal variations in solar irradiance are natural manifestations of variability. Such fluctuations can be statistically analyzed and are, to a certain extent, predictable (Holtinen et al., 2013).

Uncertainty, on the other hand, describes the deviation between forecasted and actual power generation. Errors in meteorological forecasts, sudden weather events, and localized atmospheric effects limit the accuracy of generation predictions. Especially at short time

scales—ranging from minutes to hours—uncertainty poses significant challenges for system operators (IEA, 2023).

At high renewable penetration levels, these two effects directly influence system operation strategies. As conventional power plants are gradually displaced, the availability of flexible generation capacity decreases, leading to an increased need for balancing reserves. This situation necessitates the redesign of frequency control schemes, reserve capacity planning, and market mechanisms (ENTSO-E, 2022). Consequently, modern power systems seek to manage the impacts of variability and uncertainty through the combined use of improved renewable generation forecasting, flexible resources, energy storage systems, and demand-side participation.

2.3 The Concept of Weak Grids and Its Technical Implications

With the widespread integration of renewable energy sources, the concept of the *weak grid* has become increasingly prominent in the literature. A weak grid typically refers to a power system characterized by low short-circuit strength, high network impedance, and increased sensitivity to voltage and frequency disturbances.

Weak grid conditions are particularly evident in large-scale wind and solar power plants installed in remote areas. In such regions, long transmission lines reduce short-circuit levels at connection points, making the interaction between inverter-based generation sources and the grid more critical (IEEE PES, 2020).

From a technical perspective, weak grid conditions may lead to the following consequences:

- Increased voltage fluctuations
- Amplified harmonic distortion
- Control interactions between power electronic systems
- Reduced reliability of protection systems

In cases where inverter-based generation operates in grid-following mode, weak grid conditions can result in unstable operating points or even loss of synchronization. For this reason, the concept of grid-forming inverters has gained increasing attention in recent years as a potential solution to weak grid challenges (Lasseter, 2011; Energies, 2022).

2.4 Impacts on Power Flow, Voltage Profiles, and Stability

The integration of renewable energy sources significantly alters the power flow characteristics of electrical power systems. In conventional systems, power flow is predominantly unidirectional—from generation centers to load centers. However, with the increasing penetration of distributed generation, bidirectional power flows have become widespread.

This situation complicates voltage profile control, particularly at the distribution level. In regions with high concentrations of solar energy systems, voltage rise phenomena are frequently observed under low-load and high-generation conditions. Similarly, sudden output variations of wind power plants can cause voltage oscillations at the transmission level (Sustainability, 2022).

From a stability perspective, the growing share of renewable energy sources affects both small-signal stability and transient stability. The

reduction of mechanical inertia increases system sensitivity to frequency disturbances, while inappropriate selection of inverter control parameters may exacerbate oscillatory behavior (Applied Energy, 2020).

Therefore, in modern power systems, power flow and stability analyses must extend beyond static approaches and incorporate dynamic and scenario-based methods. To ensure the secure continuation of renewable energy integration, voltage control, reactive power management, and system flexibility must be evaluated in an integrated manner.

3. POWER-ELECTRONICS-BASED INTEGRATION AND INVERTER-DOMINATED GRIDS

An examination of the historical development of electric power systems reveals that system behavior has traditionally been governed largely by the physical characteristics of synchronous generators. Mechanical inertia, electromagnetic transients, and generator–grid interactions have inherently supported frequency and voltage stability. However, with the widespread deployment of renewable energy sources, this conventional structure is increasingly being replaced by power-electronics-based integration.

Today, the majority of wind and solar power plants are connected to the grid not through synchronous generators, but via inverter and converter systems. This development indicates that modern power systems have entered a new operational regime commonly referred to as *inverter-dominated grids*. In this regime, grid behavior is shaped primarily by

control algorithms and software-based strategies rather than by physical rotating machines (Lasseter, 2011; IEEE PES, 2020).

This chapter examines the role of power electronics in modern grids, describes the DFIG, PMSG, and PV inverter structures widely used in wind and solar energy systems, compares grid-following and grid-forming inverter approaches, and analyzes the impacts of control strategies on overall system behavior

3.1 The Role of Power Electronics in Modern Grids

Power electronics plays a key role in the generation, conversion, transmission, and control of electrical energy. Advances in high-power semiconductor switching devices have enabled energy conversion processes to become more efficient, flexible, and rapidly controllable. In renewable energy systems, power electronics serves as an interface between the energy source and the grid, harmonizing their inherently different characteristics.

In modern power systems, inverters are not merely energy conversion devices; they also function as active control elements. Fundamental grid variables such as voltage magnitude, frequency, and active and reactive power flow can be precisely regulated through inverter control algorithms. While this capability provides system operators with significant flexibility, it also increases the complexity of control structures (Energies, 2021).

The main advantages offered by power-electronics-based systems include:

- Fast dynamic response capability

- Flexible active and reactive power control
- Compliance with grid codes (e.g., FRT, LVRT)
- Modular and scalable architecture

Conversely, inverter-dominated systems also exhibit inherent weaknesses. The absence of mechanical inertia, limited short-circuit contribution, and susceptibility to control interactions introduce new risks from a system stability perspective. As a result, the role of power electronics in modern grids represents not merely a technological choice, but a fundamental redefinition of power system philosophy.

3.2 DFIG, PMSG, and PV Inverter Structures

Power-electronics-based integration structures used in wind and solar energy systems vary depending on the physical characteristics of the energy source and operational requirements. In wind energy applications, the most widely used generator types are the Doubly Fed Induction Generator (DFIG) and the Permanent Magnet Synchronous Generator (PMSG), whereas solar energy systems are predominantly based on fully inverter-connected photovoltaic (PV) structures.

DFIG-based wind turbines operate on the principle of controlling the rotor windings through power electronic converters. This configuration allows variable-speed operation around synchronous speed and enables active and reactive power control using converters with relatively lower rated capacity. Despite these advantages, DFIG systems are more sensitive to grid disturbances and may require complex protection and control schemes (Ackermann, 2012).

In PMSG-based systems, the generator is fully connected to the grid through power electronic converters. This structure enables operation over a wide speed range, higher efficiency, and enhanced controllability. Due to the full-converter interface, PMSG systems can be largely decoupled from grid conditions; however, this also results in limited short-circuit current contribution (Energies, 2020).

In solar energy systems, the direct current produced by PV panels is converted into alternating current through inverters and injected into the grid. PV inverters can simultaneously perform functions such as maximum power point tracking (MPPT), voltage regulation, and reactive power support. Nevertheless, since PV systems are entirely inverter-based, their impact on grid behavior is directly dependent on control strategies.

When considered together, these three structures clearly demonstrate that modern power systems are increasingly dominated by power-electronics-based generation sources.

3.3 Grid-Following and Grid-Forming Inverters

At the core of the inverter-dominated grid concept lies the question of how inverters interact with the power system. In this context, inverters are generally classified into two fundamental operating modes: grid-following and grid-forming. The basic operational principles and differences between grid-following and grid-forming inverters are conceptually illustrated in Figure 2.

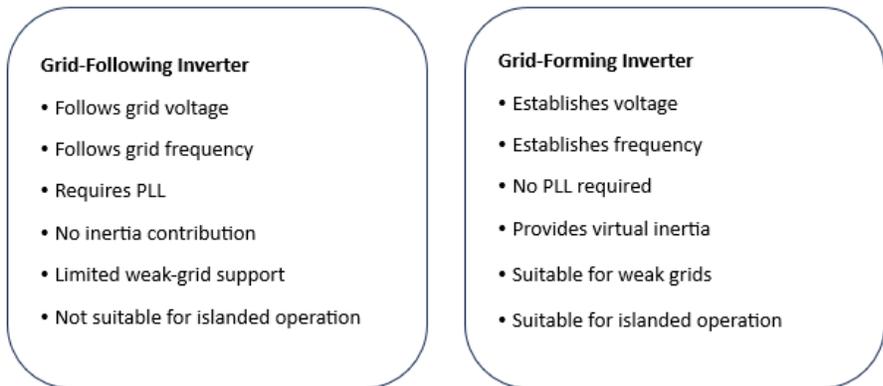


Figure 2. Conceptual comparison of grid-following and grid-forming inverters

Grid-following inverters operate by referencing the voltage and frequency already present in the grid. These inverters synchronize with the grid using a phase-locked loop (PLL) and follow predefined active and reactive power setpoints. The majority of commercially available PV and wind inverters today are designed according to the grid-following principle (IEEE PES, 2020).

While this approach performs reliably in strong and stable grids, it exhibits significant limitations under weak grid conditions. When grid voltage is unstable or short-circuit strength is low, PLL-based synchronization becomes challenging and may drive the inverter into unstable operation.

Grid-forming inverters, in contrast, are designed to establish their own reference voltage and frequency within the grid. By emulating the behavior of a virtual synchronous generator, these inverters aim to provide system inertia as well as voltage and frequency support through

software-based control. The grid-forming approach is therefore regarded as a critical solution for islanded operation, microgrids, and power systems with high renewable energy penetration (Lasseter, 2011; Energies, 2022).

The distinction between these two approaches represents one of the key factors shaping the future architecture of inverter-dominated power systems.

Table 2. Comparison of Grid-Following and Grid-Forming Inverters

Criterion	Grid-Following	Grid-Forming
Reference requirement	Grid voltage and frequency	Self-established
Use of PLL	Required	Not required
Compatibility with weak grids	Low	High
Inertia behavior	None	Virtual inertia
Islanded operation	Not suitable	Suitable
Control complexity	Low to medium	High
Future role in power systems	Decreasing	Increasing

3.4 Impact of Control Strategies on System Behavior

In power-electronics-based systems, control strategies directly determine the dynamic behavior of the overall system. Current-

controlled, voltage-controlled, droop-controlled, and virtual synchronous machine (VSM)-based approaches are selected according to specific system requirements and operating conditions.

Poorly designed control parameters may intensify interactions among inverters, leading to oscillations, amplification of harmonic components, and loss of system stability. This issue becomes particularly critical in scenarios where multiple inverters are connected to the same point of common coupling or to a weak grid, making coordinated control essential (Applied Energy, 2020).

Therefore, in modern power systems, control strategies should be designed to be:

- Sensitive to grid strength,
- Adaptive to dynamic operating conditions, and
- Compliant with applicable grid codes and standards.

The appropriate selection and coordination of control algorithms constitute a key prerequisite for the secure, stable, and sustainable operation of inverter-dominated grids.

4. HIGH-RENEWABLE-PENETRATION POWER SYSTEMS AND STABILITY CHALLENGES

When the share of renewable energy sources in electricity generation exceeds a certain threshold, the dynamic behavior of power systems changes qualitatively. At low and medium penetration levels, renewable power plants can generally be operated smoothly with the support of the existing conventional generation infrastructure. However, at high

penetration levels, new risks emerge in terms of system stability, power quality, and operational security.

The main reason for this is the reduced contribution of synchronous generators and the increasing dominance of power-electronics-based resources in high-renewable-penetration systems. The decline of mechanical inertia, reduced short-circuit strength, and increased dependence on control systems make it necessary to reassess classical topics such as frequency and voltage stability (IEEE PES, 2020; ENTSO-E, 2022; IEA Wind, 2020).

In this chapter, the main stability challenges encountered in high-renewable-penetration power systems are discussed under the following headings: frequency and voltage stability, reduced short-circuit strength problems, fault ride-through (FRT) requirements, and operational risks from a system-operator perspective.

4.1 Frequency and Voltage Stability

Frequency and voltage stability are two key dynamic variables that are essential for the secure operation of electric power systems. In conventional systems, stability is largely ensured passively through the mechanical inertia and inherent electromagnetic characteristics of large synchronous generators. However, the growing penetration of renewable energy sources weakens these natural balancing mechanisms.

From a frequency stability perspective, reduced system inertia is among the most critical impacts. As synchronous generators are displaced, system frequency responds more rapidly and with larger magnitudes to

power imbalances. This can cause frequency to deviate quickly from its nominal value during sudden generation losses or load increases (Ulbig et al., 2014).

Voltage stability becomes more complex, particularly in regions with a high concentration of inverter-based generation. While conventional plants support voltage control mainly through their reactive power capability, in inverter-based systems this support depends on the correct operation of control algorithms. Insufficient or delayed reactive power support may increase the risk of voltage collapse (Kundur, 1994).

In high-renewable-penetration systems, frequency and voltage stability are no longer independent issues; due to control interactions, they become coupled dynamics. Therefore, stability analyses must go beyond classical static approaches and be addressed using dynamic and scenario-based methods (Applied Energy, 2020).

4.2 Reduced Short-Circuit Strength Problems

Another fundamental problem frequently observed at high renewable penetration levels is the reduction of grid short-circuit strength. Short-circuit strength is an important parameter that reflects a grid's robustness against voltage disturbances and fault conditions. Synchronous generators provide high fault currents, which both support voltage stability and enable reliable operation of protection systems.

Inverter-based generation resources, by their nature, can provide only limited short-circuit current. Most inverters deliberately limit fault current to a certain multiple of rated current in order to protect semiconductor devices. This results in reduced short-circuit strength—

particularly at transmission and distribution levels—and contributes to the emergence of weak-grid conditions (IEEE Task Force on Low Short-Circuit Systems, 2020).

Reduced short-circuit strength may lead to the following technical consequences:

- Increased voltage fluctuations
- Synchronization difficulties for PLL-based inverters
- Incorrect or delayed operation of protection relays
- Increased control interactions

These problems can trigger cascading effects that threaten stability not only at the level of an individual plant, but across the entire system. For this reason, short-circuit strength has become a critical assessment criterion in the planning and operation of high-renewable-penetration power systems (Energies, 2021).

4.3 Fault Ride-Through (FRT) Requirements

One of the most important technical requirements for renewable energy plants to contribute to grid stability is fault ride-through (FRT) capability. FRT refers to the ability of a generation facility to remain connected and continue operating during short-duration voltage dips or fault events in the grid.

In the past, many renewable power plants would automatically disconnect during grid faults, leading to cascading generation losses. At high penetration levels, this behavior can cause a rapid frequency decline and may result in widespread outages. Therefore, many national

grid codes now define mandatory FRT requirements for wind and solar power plants (ENTSO-E, 2016).

FRT requirements do not only mandate that the plant stays connected; they also include providing active and reactive power support during and after the fault. In particular, reactive current injection during voltage depression significantly supports the system recovery process (IEEE Std 1547, 2018).

However, implementing FRT functions increases the complexity of inverter control systems and creates a structure more sensitive to control interactions. Poorly designed FRT strategies may amplify post-fault oscillations and lead to instability. Therefore, FRT should be treated not merely as a compliance requirement, but as a critical design topic for system stability.

4.4 Operational Risks from a System-Operator Perspective

High-renewable-penetration power systems introduce new and complex risks for system operators. These risks are not limited to technical aspects; they also result in operational and economic consequences.

From an operational perspective, the main risks can be summarized as follows:

- Insufficient frequency and voltage control reserves
- Increased imbalances due to generation and demand forecast errors
- Coordination issues between protection and control systems

- Limited response time and increased decision pressure in emergency scenarios

These risks make traditional operating procedures inadequate in high-renewable-penetration systems and require the development of new operating strategies. Real-time monitoring and state estimation systems, flexible generation resources, energy storage solutions, and advanced control algorithms have become critical tools for system operators in this new risk environment (Sustainability, 2022).

In addition, high renewable penetration transforms the operator's role into a more active, forecast-driven, and scenario-based function. Operational decisions must increasingly be based not only on the instantaneous system state, but also on uncertainties, risk assessments, and forward-looking operating scenarios. This clearly indicates that the boundary between operation and planning activities is becoming increasingly blurred in modern power systems.

5. POWER QUALITY PROBLEMS AND HARMONIC IMPACTS

In electric power systems, power quality refers to the extent to which the energy delivered to end users remains within acceptable limits in terms of voltage magnitude, frequency, and waveform characteristics. In traditional power systems, power quality problems were mainly driven by industrial loads or large rectifier systems, whereas in modern power systems these problems have become increasingly complex. The widespread integration of renewable energy sources and the growing

dominance of power-electronics-based equipment have made power quality a critical engineering challenge—on par with system stability. In inverter-dominated grid structures in particular, issues such as harmonic distortion, waveform deformation, flicker, voltage unbalance, and resonance are observed more frequently. These disturbances not only reduce equipment lifetime, but also may lead to maloperation of protection systems, increased transmission and distribution losses, and reduced overall system reliability (IEEE PES, 2020).

This chapter provides a technical framework addressing the fundamental sources of harmonics, power quality issues observed in renewable energy facilities, relevant international standards, and active, passive, and hybrid filtering solutions used to mitigate these problems.

5.1 Fundamental Sources of Harmonics

Harmonics are defined as undesirable frequency components that appear in voltage or current waveforms at integer multiples of the fundamental frequency. In an ideal power system, voltage and current waveforms should be purely sinusoidal. In practice, however, non-linear loads and power-electronics-based devices distort these waveforms.

In conventional power systems, the main sources of harmonics include rectifiers, arc furnaces, variable frequency drives (VFDs), fluorescent lighting, and transformers operating in saturation. Such equipment draws non-sinusoidal currents from the grid, producing harmonic currents. These currents are converted into voltage harmonics through

the network impedance and propagate throughout the system (Arrillaga et al., 2003).

In modern power systems, the profile of harmonic sources has changed significantly. Inverters used in renewable energy systems operate based on high-frequency switching principles and may generate both low-order and high-order harmonics. Switching frequency, filter topology, and control algorithms directly determine the characteristics of the harmonic spectrum (Bollen & Hassan, 2011).

The impacts of harmonics on power systems can be summarized as follows:

- Additional losses and heating in transformers and cables
- Distortion of the voltage waveform
- Incorrect operation of protection and measurement systems
- Increased resonance risk

These impacts become more pronounced in high-renewable-penetration systems, making power quality an integral part of overall system stability.

5.2 Power Quality Issues in Renewable Energy Facilities

Renewable energy facilities are at the center of power quality challenges because they inherently rely on power-electronics-based interfaces. Power quality issues observed in wind and solar power plants are not limited to harmonics; flicker, voltage fluctuations, and unbalance are also common.

In wind power plants, especially those using DFIG-based turbines, sudden changes in wind speed lead to active power fluctuations. These

fluctuations can be perceived as voltage flicker at the transmission level. Although this effect can be better controlled in PMSG and full-converter systems, similar issues may arise if inverter control parameters are insufficient or poorly tuned (Ackermann, 2012).

In solar power plants, sudden cloud transients can cause short-duration but high-amplitude power variations. In regions with high PV penetration at the distribution level, these variations appear as voltage rises and voltage fluctuations. In addition, if PV inverter synchronization and MPPT algorithms are not properly designed, harmonic amplification may occur (IEA PVPS, 2022).

The impacts of power quality problems in renewable energy plants are observed not only on the grid side but also within plant equipment. Increased thermal stress in inverters, transformers, and cables reduces equipment lifetime and raises maintenance costs. Therefore, power quality has become not only a compliance criterion but also a critical parameter for the economic sustainability of renewable energy projects.

5.3 IEEE 519 and IEC 61000 Standards

International standards play a critical role in the systematic management of power quality problems. In this context, one of the most widely used standards is IEEE 519. IEEE 519 defines permissible voltage and current harmonic levels at the Point of Common Coupling (PCC) and specifies limit values for total harmonic distortion (THD).

According to IEEE 519, the voltage THD at the PCC should generally be kept below 5%. For current harmonics, the limit values vary depending on the ratio of the grid short-circuit strength to the load

current (IEEE Std 519-2014). This approach is important because it accounts for the determining role of grid electrical strength in harmonic impacts.

The IEC 61000 series provides a broader framework under electromagnetic compatibility (EMC). This series includes many sub-standards covering harmonics, flicker, voltage fluctuations, and immunity requirements. In particular, IEC 61000-3 and IEC 61000-4 are widely used to assess the power quality performance of equipment deployed in renewable energy facilities.

These standards do not only specify limit values; they also provide a technical framework that guides design, testing, and verification processes. Compliance with power quality standards is considered a fundamental requirement for inverter-based renewable energy facilities to operate compatibly with the grid, ensuring equipment safety and operational continuity (IEEE Std 519-2014; IEC 61000). Achieving the limits defined by these standards in practice often requires additional engineering solutions.

5.4 Active, Passive, and Hybrid Filtering Solutions

Among the most common engineering solutions for mitigating power quality problems are filtering systems. These filters are used to suppress harmonic currents or prevent their propagation through network impedance. Filtering solutions are generally classified as passive, active, and hybrid filters.

Passive filters are based on tuning inductance (L), capacitance (C), and resistance (R) elements to specific frequencies. Their key advantages

are effectiveness against certain harmonic orders and relatively low cost. However, resonance risk, fixed tuning characteristics, and limited adaptability under varying load conditions are major disadvantages (Arrillaga et al., 2003).

Active filters are power-electronics-based systems that measure harmonic currents in real time and generate compensating currents with opposite phase. This approach offers significant advantages in broadband harmonic mitigation and adaptability to varying operating conditions. Nevertheless, active filters have higher costs, increased control complexity, and stronger dependence on power-electronic components (Bollen & Hassan, 2011).

Hybrid filters were developed to combine the advantages of passive and active filters. These structures typically employ passive filters for low-order harmonics and active filters for variable and higher-order harmonics. Especially in large-scale renewable power plants, hybrid filtering solutions are considered attractive in terms of performance–cost balance (Applied Energy, 2020).

Filter selection and design should not be based solely on harmonic levels. Network impedance, short-circuit strength, inverter operating characteristics, and potential resonance scenarios must be evaluated together. Otherwise, poorly coordinated filtering solutions may create new resonance conditions or negatively affect operational security instead of mitigating power quality problems (Arrillaga et al., 2003; Bollen & Hassan, 2011).

6. HVDC AND ADVANCED TRANSMISSION TECHNOLOGIES

The rapid growth of renewable energy sources has necessitated profound transformations not only on the generation side but also within transmission infrastructures. The fact that large-scale wind and solar power plants are often located far from major load centers has pushed conventional AC transmission systems to their technical and economic limits. In this context, High Voltage Direct Current (HVDC) systems have emerged as one of the most critical components of renewable energy integration in modern power systems.

HVDC technologies offer significant advantages in applications such as long-distance power transmission, submarine cable connections, and the interconnection of asynchronous power systems. In today's power systems—where inverter-dominated grid structures are becoming increasingly prevalent—HVDC is no longer regarded merely as an alternative transmission option, but rather as a strategic tool for enhancing system stability and controllability (CIGRÉ, 2019; IEEE PES, 2020).

This chapter examines the role of HVDC systems in renewable energy integration, provides a technical discussion of VSC-HVDC and MMC-HVDC architectures, explores offshore and remote-area integration scenarios, and evaluates stability and control aspects within a comprehensive and system-oriented framework.

6.1 Role of HVDC Systems in Renewable Energy Integration

The primary advantage of HVDC systems lies in their ability to transmit electrical energy over long distances with low losses and a high degree of controllability. In AC transmission systems, increasing distance leads to a significant rise in reactive power requirements, voltage drops, and stability limitations, whereas HVDC systems eliminate a large portion of these constraints.

From the perspective of renewable energy integration, the role of HVDC can be classified into three main categories. The first is the transmission of large-scale wind and solar power plants from remote locations to major load centers. The second is the connection of offshore wind farms to onshore grids via submarine cables. The third is the interconnection of power systems with different frequencies or operating characteristics (Ackermann, 2012).

Because HVDC systems allow full control of active power flow, they help balance the variability of renewable energy sources at the system level. Unlike AC systems, where power flow is largely determined by network impedances, HVDC power transfer can be directly regulated through control systems. This capability provides a major advantage in managing transmission bottlenecks in systems with high renewable energy penetration (ENTSO-E, 2022).

In addition, HVDC interconnections can provide electrical isolation between AC systems under fault conditions, thereby preventing the propagation of stability problems. In this sense, HVDC is often regarded as a “stability barrier” in modern power systems.

6.2 VSC-HVDC and MMC-HVDC Architectures

One of the most significant developments in the evolution of HVDC technologies is the transition from Line Commutated Converter (LCC)–based systems to Voltage Source Converter (VSC)–based systems. Although LCC-HVDC systems are effective at very high-power levels, their need for reactive power support, extensive harmonic filtering, and limited capability to connect to weak grids make them less suitable for renewable energy integration.

VSC-HVDC systems, on the other hand, can independently control active and reactive power due to their power-electronics-based structure. They are capable of connecting to weak grids and can even energize passive networks. These features make VSC-HVDC an ideal solution for offshore wind power plants and inverter-dominated grid structures (IEEE PES, 2020).

Modular Multilevel Converter (MMC)–based HVDC systems are widely regarded as the most advanced form of VSC technology.

According to CIGRÉ technical studies, the modular submodule-based architecture of MMC-HVDC systems provides several key advantages, including (CIGRÉ, 2019):

- Lower harmonic distortion levels
- Higher efficiency
- Improved scalability
- Reduced filtering requirements

MMC-HVDC systems have significantly enhanced the performance of VSC-HVDC technology, particularly at high power levels, and have accelerated the widespread adoption of HVDC solutions. As a result,

HVDC has evolved from a niche application into one of the core transmission technologies in modern power systems.

6.3 Offshore and Remote-Area Integration

Offshore wind energy has gained increasing importance in renewable energy investments due to its high-capacity factors and more stable wind regimes. However, integrating offshore wind farms into onshore grids presents substantial engineering challenges. In submarine cable applications, AC transmission becomes technically and economically inefficient beyond a certain distance because of capacitive effects.

At this point, HVDC emerges as an almost indispensable technology for offshore integration. VSC-HVDC and MMC-HVDC systems enable wind farms to be connected to the onshore grid in an electrically independent manner by providing voltage and frequency formation capabilities at offshore platforms (Ackermann, 2012; Energies, 2021). Similarly, for large-scale solar power plants located in desert regions or wind farms situated in mountainous areas, HVDC plays a critical role in reducing losses and mitigating stability problems associated with long-distance transmission. In such projects, HVDC is not only a technical solution but also a key determinant of overall economic feasibility (Applied Energy, 2020).

Another important contribution of HVDC in offshore and remote-area integration is the flexibility it provides in system planning. Multiterminal HVDC (MTDC) configurations offer significant potential for the future interconnection of renewable energy hubs and the realization of “supergrid” concepts.

6.4 Stability and Control Perspective

One of the most important roles of HVDC systems in modern power systems is the flexibility they provide in terms of stability and control. VSC- and MMC-based HVDC systems can deliver frequency and voltage support services thanks to their fast control capabilities. This feature is particularly critical for maintaining system stability in inverter-dominated grid environments.

HVDC interconnections can provide frequency support through active power modulation and contribute to voltage profile regulation via reactive power control. These functionalities transform HVDC from a passive transmission link into an active system component (IEEE PES, 2020).

Nevertheless, the control of HVDC systems is more complex than that of conventional AC systems. Multiple control loops, AC–DC interactions, and dynamics operating across different time scales require careful design and coordination. Improperly configured control strategies may introduce new instability mechanisms instead of enhancing system stability (CIGRÉ, 2019).

For this reason, during the planning and operation of HVDC systems, the following aspects are of critical importance:

- Joint modeling of AC and DC systems
- Scenario-based dynamic analyses
- Integrated design of protection and control systems

In modern power systems, HVDC should be regarded as a powerful tool that enhances stability when properly designed, but as a complex

component capable of amplifying system risks when poorly implemented.

7. ENERGY STORAGE AND ENABLING TECHNOLOGIES

The increasing share of renewable energy sources in electric power systems has necessitated a reassessment of system design not only in terms of generation capacity but also with respect to flexibility. Wind and solar energy sources, characterized by variable and uncertain generation profiles, challenge the balancing mechanisms upon which conventional power systems have relied for decades, thereby requiring new solutions for frequency control, voltage regulation, and power flow management.

In this context, Energy Storage Systems (ESS) and flexibility-enhancing enabling technologies have become indispensable components of modern power systems. ESS and FACTS devices play a critical role not only in addressing technical challenges but also in enhancing system operational security, economic efficiency, and planning optimization (IEA, 2022; IEEE PES, 2020).

This chapter examines the main types of energy storage systems and their integration into power grids, the role of FACTS devices, the concept of flexibility in renewable energy integration, and the operational and planning impacts of these technologies.

7.1 Types of Energy Storage Systems and Grid Integration

Energy Storage Systems (ESS) can be defined as technologies that enable electrical energy to be stored for a certain period and supplied back to the system when required. ESS technologies are categorized according to criteria such as time scale, power and energy capacity, efficiency, and response time.

The most widely used energy storage technologies include Battery Energy Storage Systems (BESS), Pumped Hydroelectric Storage (PHS), supercapacitors, flywheels, and hydrogen-based storage solutions. Pumped hydroelectric storage systems have traditionally played a significant role in system balancing due to their large energy capacity and long-duration storage capability. However, geographical constraints and high capital investment costs limit their widespread deployment (IEA, 2022).

Battery Energy Storage Systems, on the other hand, have become increasingly prominent in renewable energy integration due to their modular structure, fast response times, and suitability for distributed applications. In particular, lithium-ion batteries provide effective solutions for frequency regulation, peak load shaving, and short-term backup services (Energies, 2021).

The grid integration of ESS is not limited to hardware selection alone. Decisions regarding the location, capacity, and control strategies of storage systems have a direct impact on overall system performance. ESS deployed at the distribution level can provide local voltage control and power quality improvement, whereas large-scale ESS installed at

the transmission level play a critical role in system-wide frequency regulation and power balancing (Applied Energy, 2020).

7.2 Role of FACTS Devices (STATCOM, SVC)

Flexible AC Transmission Systems (FACTS) refer to power-electronics-based devices developed to enhance power flow control, voltage regulation, and reactive power management in transmission and distribution networks. FACTS devices are considered key enablers for improving grid flexibility, particularly in systems with high renewable energy penetration.

Among the most widely used FACTS devices are the Static Var Compensator (SVC) and the Static Synchronous Compensator (STATCOM). SVCs are based on thyristor-controlled reactors and capacitor banks, whereas STATCOMs rely on voltage-source inverter technology, offering faster and more precise reactive power control capabilities (IEEE PES, 2020).

From the perspective of renewable energy integration, the primary contributions of FACTS devices include:

- Mitigation of voltage fluctuations
- Provision of reactive power balance
- Enhancement of power transfer capability
- Extension of system stability margins

In regions with a high concentration of wind power plants, devices such as STATCOMs and SVCs improve system reliability by providing voltage support during rapid generation changes. In addition, FACTS devices enable more efficient utilization of existing transmission lines,

thereby contributing to the deferral of costly new transmission investments (CIGRÉ, 2019).

7.3 Flexibility in Renewable Energy Integration

Flexibility has become one of the most critical concepts determining the success of renewable energy integration in modern power systems. Flexibility refers to the ability of a power system to respond rapidly and effectively to generation–load imbalances, sudden disturbances, and uncertainties.

In conventional power systems, flexibility has largely been provided by the load-following capability of conventional generation units. However, this mechanism becomes insufficient in renewable-dominated systems. In this context, ESS, FACTS devices, demand-side participation, and advanced control strategies are jointly utilized to enhance system flexibility (IEA, 2023).

Energy storage systems support flexibility by providing frequency regulation and power balancing over short time scales, while FACTS devices contribute through voltage regulation and reactive power control. When deployed together, these technologies enable more effective management of the variability associated with renewable energy sources.

Enhancing system flexibility is not only a technical necessity but also an economic and environmental imperative. In systems with insufficient flexibility, renewable energy curtailment becomes unavoidable, whereas adequate flexibility allows a higher share of clean energy to be securely integrated into the grid.

7.4 Operational and Planning Impacts

The widespread deployment of energy storage and enabling technologies has fundamentally transformed power system operation and planning approaches. While traditional planning methodologies focused primarily on generation capacity and transmission infrastructure, modern power systems increasingly consider the location and capacity of flexibility resources as critical planning parameters.

From an operational perspective, ESS and FACTS devices provide system operators with a broader range of control actions. Real-time control capabilities enable faster and more effective responses during emergency scenarios. However, this also increases operational complexity and intensifies the need for advanced monitoring and decision-support systems (Sustainability, 2022).

From a planning standpoint, investments in ESS and FACTS technologies must be evaluated alongside transmission expansion and new generation projects. Strategically located storage or FACTS installations can defer or even eliminate the need for high-cost infrastructure investments (Applied Energy, 2020).

Consequently, operation and planning in modern power systems are no longer independent processes; instead, they must be addressed through an integrated and holistic framework.

8. TECHNICAL–ECONOMIC ASSESSMENT AND SYSTEM PLANNING

Renewable energy integration represents not only a technical transformation but also a process that fundamentally reshapes the economic structure and planning philosophy of power systems. The variable nature of resources such as wind and solar energy requires investment decisions to be based not solely on installed capacity and energy output, but also on system flexibility, transmission infrastructure, operational costs, and long-term risks.

In traditional power system planning, generation investments have largely been evaluated based on fuel costs, capacity factors, and demand projections. However, this approach becomes insufficient in modern power systems. In systems with high renewable energy penetration, technical and economic dimensions are increasingly inseparable, and system planning has evolved into a multidisciplinary optimization problem (IEA, 2023; Applied Energy, 2020).

This chapter explains the key concepts commonly used in techno-economic assessment, including LCOE, CAPEX, and OPEX; examines the economic impacts of renewable energy integration; analyzes transmission losses and optimization issues; and provides an engineering-oriented perspective for decision-makers.

8.1 Concepts of LCOE, CAPEX, and OPEX

One of the most frequently used indicators in techno-economic analyses is the Levelized Cost of Energy (LCOE). LCOE represents the unit cost of energy produced by a power generation facility, calculated as the

ratio of the total lifetime costs to the total energy generated over the plant's operational life. This metric provides a practical tool for comparing different generation technologies (IEA, 2022).

The LCOE calculation primarily consists of three main cost components:

- CAPEX (Capital Expenditure): Initial investment costs
- OPEX (Operational Expenditure): Operation and maintenance costs
- Financing costs and discount rates

In renewable energy projects, CAPEX is typically high, while OPEX remains relatively low. In particular, the near-zero fuel cost of wind and solar energy makes these technologies economically attractive over the long term. However, the limitations of relying solely on LCOE become more evident in systems with high renewable penetration.

While LCOE calculations are generally performed at the plant level, system-level costs—such as transmission investments, flexibility requirements, energy storage, and reserve capacity—are not directly reflected in these assessments. As a result, the true system costs associated with renewable energy investments may be underestimated when LCOE is used as the sole decision-making criterion (Applied Energy, 2020).

8.2 Economic Impacts of Renewable Energy Integration

The economic impacts of renewable energy integration are not limited solely to generation costs. These impacts encompass a wide range of

factors, including electricity market prices, transmission investments, system operation costs, and flexibility requirements.

In systems with high renewable energy penetration, the reduction in marginal generation costs leads to downward pressure on electricity market prices. While this may appear advantageous for consumers in the short term, it can undermine the long-term economic viability of flexible and backup capacity investments (IEA, 2023).

Moreover, renewable energy power plants are often located far from load centers, which necessitates additional investments in transmission infrastructure. These investments are not directly reflected in plant-level costs, yet they impose a significant economic burden at the system level. Economic assessments that neglect transmission investments may therefore lead to misleading conclusions for decision-makers (ENTSO-E, 2022).

Another important economic consequence of renewable energy integration is generation curtailment. The inability to absorb produced clean energy due to insufficient transmission capacity or lack of system flexibility results in both economic losses and deviations from environmental targets. Consequently, modern planning approaches must evaluate all system-level economic impacts of renewable energy integration in an integrated manner.

8.3 Transmission Losses and Optimization

Transmission losses are unavoidable technical losses that occur during the transfer of electrical energy from generation sites to consumption

points. Renewable energy integration can significantly influence both the spatial distribution and the overall magnitude of these losses.

The remote location of large-scale wind and solar power plants reshapes power flow patterns and can lead to congestion in specific transmission corridors. This situation may increase losses and reduce overall system efficiency (Applied Energy, 2020).

Optimization strategies aimed at reducing transmission losses include:

- Balancing generation and consumption locations
- Reinforcing transmission infrastructure
- Deploying HVDC and FACTS technologies
- Strategically positioning energy storage systems

In particular, HVDC interconnections offer substantial advantages in reducing losses over long-distance transmission and enabling more effective power flow control.

In modern power systems, transmission loss optimization is not solely a technical challenge but also an economic optimization problem. Reducing losses lowers generation costs and enhances overall system efficiency. For this reason, loss analysis has become an integral component of techno-economic assessments.

8.4 Engineering Perspective for Decision-Makers

Decisions related to renewable energy investments can no longer be based solely on engineering calculations or economic indicators. Technical complexity, market uncertainties, and long-term risks necessitate a holistic perspective for effective decision-making.

From an engineering standpoint, robust decision-making processes should include:

- System-level technical analyses
- Scenario-based economic evaluations
- Consideration of flexibility and stability requirements
- Assessment of long-term operational risks

This approach prioritizes long-term system sustainability over short-term cost advantages. Particularly in systems with high renewable energy penetration, balanced and flexible solutions should be favored over low-cost options that pose systemic risks (IEA, 2023).

One of the most critical takeaways for decision-makers is the recognition that renewable energy integration is not merely a power plant investment, but a system-wide transformation. Successfully managing this transformation depends on the coherent and integrated treatment of technical and economic analyses.

9. FUTURE POWER SYSTEMS

Electrical power systems are undergoing a historic transformation driven by the accelerating integration of renewable energy sources. This transformation is not limited to the improvement of existing technologies; rather, it entails fundamental changes in how power systems are designed, operated, and controlled. While traditional power systems have been dominated by synchronous generators, they are increasingly being replaced by inverter-dominated grid architectures. As a result, future power systems are becoming more digital, more predictive, and more autonomous in nature.

This section examines the key technological and conceptual trends shaping future power systems. Grid-forming inverters, digital twin approaches, artificial intelligence–assisted grid operation, and emerging trends in energy systems are discussed as defining elements in the evolution of modern power systems.

9.1 Grid-Forming Inverters

One of the most fundamental challenges encountered in power systems with high renewable energy penetration is the lack of sufficient synchronous generators to establish and maintain system frequency and voltage references. This challenge has exposed the limitations of conventional grid-following inverter approaches in inverter-dominated grid structures. In this context, grid-forming inverters have emerged as a critical technology for future power systems.

Grid-forming inverters are designed to operate without relying on an existing grid voltage or frequency reference; instead, they actively establish these references themselves. By emulating the dynamic behavior of synchronous generators, grid-forming inverters provide system inertia, frequency response, and voltage regulation through software-based control algorithms (Lasseter, 2011; IEEE PES, 2020).

This approach offers significant advantages, particularly in islanded operation, microgrids, and scenarios where systems operate without synchronous generators. Through the deployment of grid-forming inverters, renewable energy sources transition from being passive energy providers to active components that contribute directly to system stability.

Nevertheless, the widespread adoption of grid-forming inverters requires careful consideration of control coordination, standardization, and system-level interactions. The concurrent operation of multiple grid-forming inverters within the same power system may introduce new instability mechanisms if control strategies are improperly designed or inadequately coordinated. Therefore, while the grid-forming paradigm holds substantial promise for future power systems, it must be regarded as a domain that demands rigorous engineering design and comprehensive system-level analysis.

9.2 Digital Twins and Advanced Monitoring

Future power systems are increasingly managed not only through physical infrastructures but also through their digital representations. The concept of a digital twin refers to the creation of a digital replica of a physical system that is continuously updated using real-time data. This approach opens new horizons for the monitoring, analysis, and optimization of power systems.

By integrating real-time measurements, historical data, and advanced simulation models, digital twins enable a deeper understanding of system behavior under both normal and abnormal operating conditions. This capability supports predictive analysis, early fault detection, and proactive decision-making, thereby enhancing system reliability and operational efficiency.

For future power systems, an integrated operational framework based on digital twins and artificial intelligence provides a powerful foundation for advanced monitoring, forecasting, and control. A

conceptual illustration of such an integrated digital twin and AI-based operational framework for future power systems is presented in Figure 3.

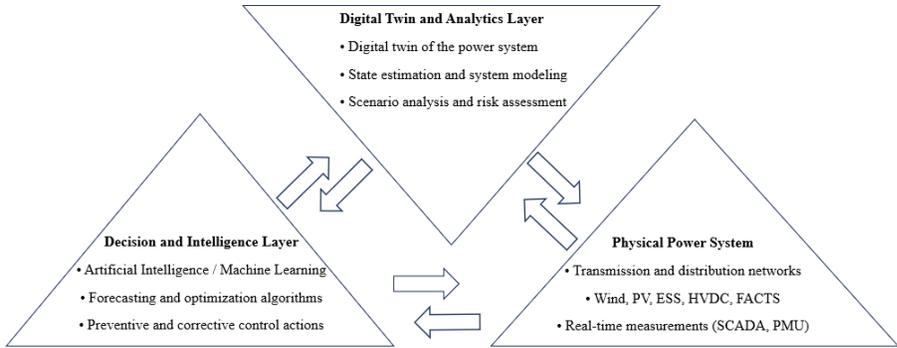


Figure 3. Digital twin and AI-assisted architecture for future power system operation

Digital twin technologies are capable of representing the real-time state of power systems with high accuracy by utilizing data obtained from sensors, SCADA systems, Phasor Measurement Units (PMUs), and advanced communication infrastructures. Through this capability, system operators are not only able to monitor current operating conditions, but also to test potential scenarios in advance and anticipate emerging risks (CIGRÉ, 2021).

Advanced monitoring systems are of critical importance, particularly in power grids characterized by high renewable energy penetration and complex power flow patterns. Issues such as voltage fluctuations, frequency oscillations, and harmonic amplification can be detected at an early stage through digital twins, enabling the implementation of

preventive and corrective measures before they escalate into system-wide problems.

The digital twin approach shifts power system operation from a reactive paradigm toward a proactive and predictive operational model. This transformation plays a fundamental role in enhancing reliability and flexibility in future power systems.

9.3 Artificial Intelligence–Assisted Grid Operation

The increasing complexity of power systems has revealed the limitations of conventional deterministic operation and control methods. Variable generation, inherent uncertainties, and multi-dimensional optimization problems make the adoption of data-driven and learning-based systems increasingly inevitable. In this context, Artificial Intelligence (AI) and Machine Learning (ML) techniques are expected to play a significant role in the operation of future power grids. AI-assisted approaches are widely applied in renewable generation forecasting, fault detection, state estimation, and decision-support systems. Owing to their ability to learn from large datasets, AI-based systems can provide more flexible and adaptive solutions compared to classical model-based approaches (Applied Energy, 2021).

For instance, in wind and solar power generation forecasting, deep learning–based models can significantly reduce uncertainty by jointly processing meteorological data and historical production records. Similarly, in fault detection and classification processes, AI algorithms are capable of analyzing system events more rapidly and accurately, enabling faster response and improved operational reliability.

However, the integration of artificial intelligence into grid operation also introduces new challenges related to transparency, reliability, and cybersecurity. For this reason, AI-based solutions should be regarded as complementary tools that augment classical engineering principles, rather than fully autonomous and unsupervised control systems.

9.4 Emerging Trends in Energy Systems

Future power systems are being shaped not by isolated technological advancements, but by the simultaneous influence of multiple converging trends. Among these trends, distributed generation, microgrids, multi-terminal HVDC architectures, sector coupling, and carbon neutrality targets stand out as key drivers of transformation.

Microgrids enhance system flexibility and improve the reliability of critical loads by enabling the local balancing of generation and consumption. Multi-terminal HVDC (MTDC) systems, on the other hand, offer new opportunities for intercontinental power exchange and the large-scale integration of renewable energy hubs (ENTSO-E, 2022). In addition, the integration of the electricity, heating, and transportation sectors necessitates a holistic approach to energy system planning and operation. Electric vehicles, heat pumps, and hydrogen-based technologies are increasingly regarded as both flexible loads and potential sources of system flexibility in future power systems.

The common denominator of these trends is the transition of power systems from static and closed structures toward dynamic, data-driven, and multi-actor systems. Successfully managing this transformation

requires the combined application of sound engineering expertise and strategic system-level planning.

10. CONCLUSIONS AND OVERALL ASSESSMENT

This book has examined the structural transformation of electric power systems under the rapidly increasing integration of renewable energy sources from technical, economic, and operational perspectives. The growing dominance of inverter-based generation technologies, such as wind and solar power, is invalidating many classical assumptions of conventional power systems and necessitating the adoption of new engineering paradigms. In this context, each chapter of the book has aimed to present the challenges faced by modern power systems and the corresponding solution frameworks through a holistic and system-oriented approach.

Traditional power systems have historically been built upon high-inertia synchronous generators, strong short-circuit levels, and relatively predictable generation profiles. However, with the increasing penetration of renewable energy sources, system behavior has become progressively more dependent on power-electronics-based control mechanisms. This transformation does not merely represent a change in technical parameters; it also requires a fundamental redefinition of system planning, operation, and decision-making processes.

10.1 Key Insights from the Technical Transformation

The technical analyses presented throughout the book clearly demonstrate that inverter-dominated grid structures exhibit

qualitatively different behavior compared to conventional power systems. Frequency and voltage stability are no longer governed solely by the inherent physical responses of rotating machines, but are increasingly shaped by software-based control algorithms. This shift highlights the evolution of power systems from a “hardware-centric” architecture toward a “control- and software-centric” paradigm.

In high renewable penetration systems, factors such as:

- the reduction of mechanical inertia,
- the decrease in short-circuit strength, and
- the increase in control interactions

render system stability more sensitive and inherently fragile. Consequently, grid-forming inverters, advanced control strategies, energy storage systems, and FACTS devices should no longer be regarded as auxiliary or supplementary solutions, but rather as fundamental building blocks of modern power systems.

Moreover, HVDC technologies are emerging not only as long-distance transmission solutions, but also as active control instruments that support overall system stability. VSC-HVDC and MMC-HVDC architectures play a critical role in providing the flexibility and controllability required by inverter-dominated grids.

10.2 Integrated Consideration of Power Quality and System Stability

One of the key conclusions of this study is that power quality and system stability can no longer be treated as independent concepts. Power quality phenomena such as harmonics, voltage fluctuations, and

flicker can directly evolve into stability-related issues in power systems with high renewable energy penetration.

Although standards such as IEEE 519 and IEC 61000 provide an essential framework for power quality assessment, compliance with these standards alone does not guarantee secure system operation. Particularly under weak grid conditions, harmonic interactions and control-related resonances may dominate system behavior beyond the limits defined by standard threshold values.

Therefore, in modern power systems:

- power quality analyses,
- dynamic stability studies, and
- control coordination

must be evaluated jointly and in an integrated manner. Unless filter solutions, inverter control strategies, and grid impedance characteristics are addressed at the system level, locally optimized solutions may inadvertently lead to new system-wide problems.

10.3 Assessment from Technical–Economic and Operational Perspectives

The evaluation of renewable energy integration cannot be reduced solely to plant-level indicators such as LCOE, CAPEX, and OPEX. As emphasized throughout this book, the actual costs emerge at the system level. Transmission infrastructure investments, flexibility requirements, energy storage solutions, and operational risks constitute integral components of renewable energy integration.

In systems with high renewable penetration, economic efficiency is directly linked to technical adequacy. Insufficient flexibility or improper planning may result in increased curtailment, higher operational costs, and reduced investment efficiency. This reality clearly demonstrates that technical and economic analyses can no longer be conducted independently.

From an operational perspective, the role of system operators is becoming increasingly active and foresight-driven. Real-time monitoring, advanced forecasting techniques, and decision-support systems have become indispensable tools for ensuring the secure operation of modern power systems.

10.4 Future Outlook and Strategic Implications

Future power systems will require not only higher levels of renewable energy integration, but also more digital, intelligent, and flexible system architectures. Grid-forming inverters, digital twins, and artificial intelligence-supported operational approaches stand out as the fundamental building blocks of this transformation.

However, the successful deployment of these technologies must be achieved without compromising the core principles of engineering discipline. Data-driven and autonomous systems should be developed in alignment with transparency, reliability, and auditability requirements. Otherwise, technological advancement may introduce new risks to system reliability.

For decision-makers, the most important strategic takeaway is the recognition that renewable energy integration represents not a

“technology selection,” but a comprehensive “system transformation.” Managing this transformation successfully requires a holistic approach in which technical analysis, economic evaluation, and long-term planning are jointly addressed.

10.5 Overall Evaluation

This book has addressed the technical and economic challenges encountered by modern power systems during the renewable energy integration process from an engineering-oriented and application-driven perspective. The topics discussed aim not only to provide an academic framework, but also to offer practical guidance for field applications, system operation, and decision-making processes.

The secure, sustainable, and cost-effective operation of renewable-energy-dominated power systems is achievable only through flexible and holistic engineering solutions that extend beyond classical approaches. In this context, the analyses and evaluations presented in this book are intended to serve as a guiding reference for engineers, researchers, and decision-makers working in the field of modern power systems.

REFERENCES

- Ackermann, T. (Ed.). (2012). Wind power in power systems (2nd ed.). Wiley.
- Arrillaga, J., Watson, N. R., & Chen, S. (2003). Power system quality assessment. Wiley.
- Bollen, M. H. J., & Hassan, F. (2011). Integration of distributed generation in the power system. Wiley-IEEE Press.
- CIGRÉ. (2019). HVDC grid feasibility study. CIGRÉ Technical Brochure.
- CIGRÉ. (2021). Digital twins in power systems. CIGRÉ Working Group Report.
- ENTSO-E. (2016). Network code on requirements for generators (RfG). European Network of Transmission System Operators for Electricity.
- ENTSO-E. (2022). Power system flexibility needs in the energy transition. ENTSO-E.
- Energies. (2020). Power electronics-based technologies for renewable energy integration. *Energies*, 13(418).
<https://doi.org/10.3390/en13020418>
- Energies. (2021). Inverter-dominated power systems: Stability and control challenges. *Energies*, 14(6467).
<https://doi.org/10.3390/en14206467>
- Energies. (2022). Grid-forming converters and system stability in low-inertia power systems. *Energies*, 15(519).
<https://doi.org/10.3390/en15020519>

- Holttinen, H., et al. (2013). Design and operation of power systems with large amounts of wind power. *Wind Energy*, 16(3), 321–334. <https://doi.org/10.1002/we.1520>
- IEA. (2022). Energy storage. International Energy Agency.
- IEA. (2023). World energy outlook. International Energy Agency.
- IEA PVPS. (2022). Trends in photovoltaic applications. International Energy Agency Photovoltaic Power Systems Programme.
- IEA Wind. (2020). Wind power grid integration: The state of the art. International Energy Agency.
- IEEE Power & Energy Society. (2020). Power system dynamic performance: Challenges and solutions for low inertia and high penetration of inverter-based resources. IEEE PES Task Force Report.
- IEEE Standards Association. (2014). IEEE recommended practice and requirements for harmonic control in electric power systems (IEEE Std 519-2014). IEEE.
- IEEE Standards Association. (2018). IEEE standard for interconnection and interoperability of distributed energy resources with associated electric power systems interfaces (IEEE Std 1547-2018). IEEE.
- Kundur, P. (1994). Power system stability and control.
- Lasseter, R. H. (2011). Smart distribution: Coupled microgrids. *Proceedings of the IEEE*, 99(6), 1074–1082. <https://doi.org/10.1109/JPROC.2011.2114630>

Sustainability. (2022). Technical, economic and environmental assessment of wind power integration considering power quality and FACTS devices. *Sustainability*, 14, 2507.

<https://doi.org/10.3390/su14042507>

Ulbig, A., Borsche, T. S., & Andersson, G. (2014). Impact of low rotational inertia on power system stability and operation. *IFAC Proceedings Volumes*, 47(3), 7290–7297.

<https://doi.org/10.3182/20140824-6-ZA-1003.02696>

**INTEGRATION OF RENEWABLE ENERGY INTO MODERN POWER SYSTEMS: TECHNICAL,
ECONOMIC, AND POWER QUALITY PERSPECTIVES**

